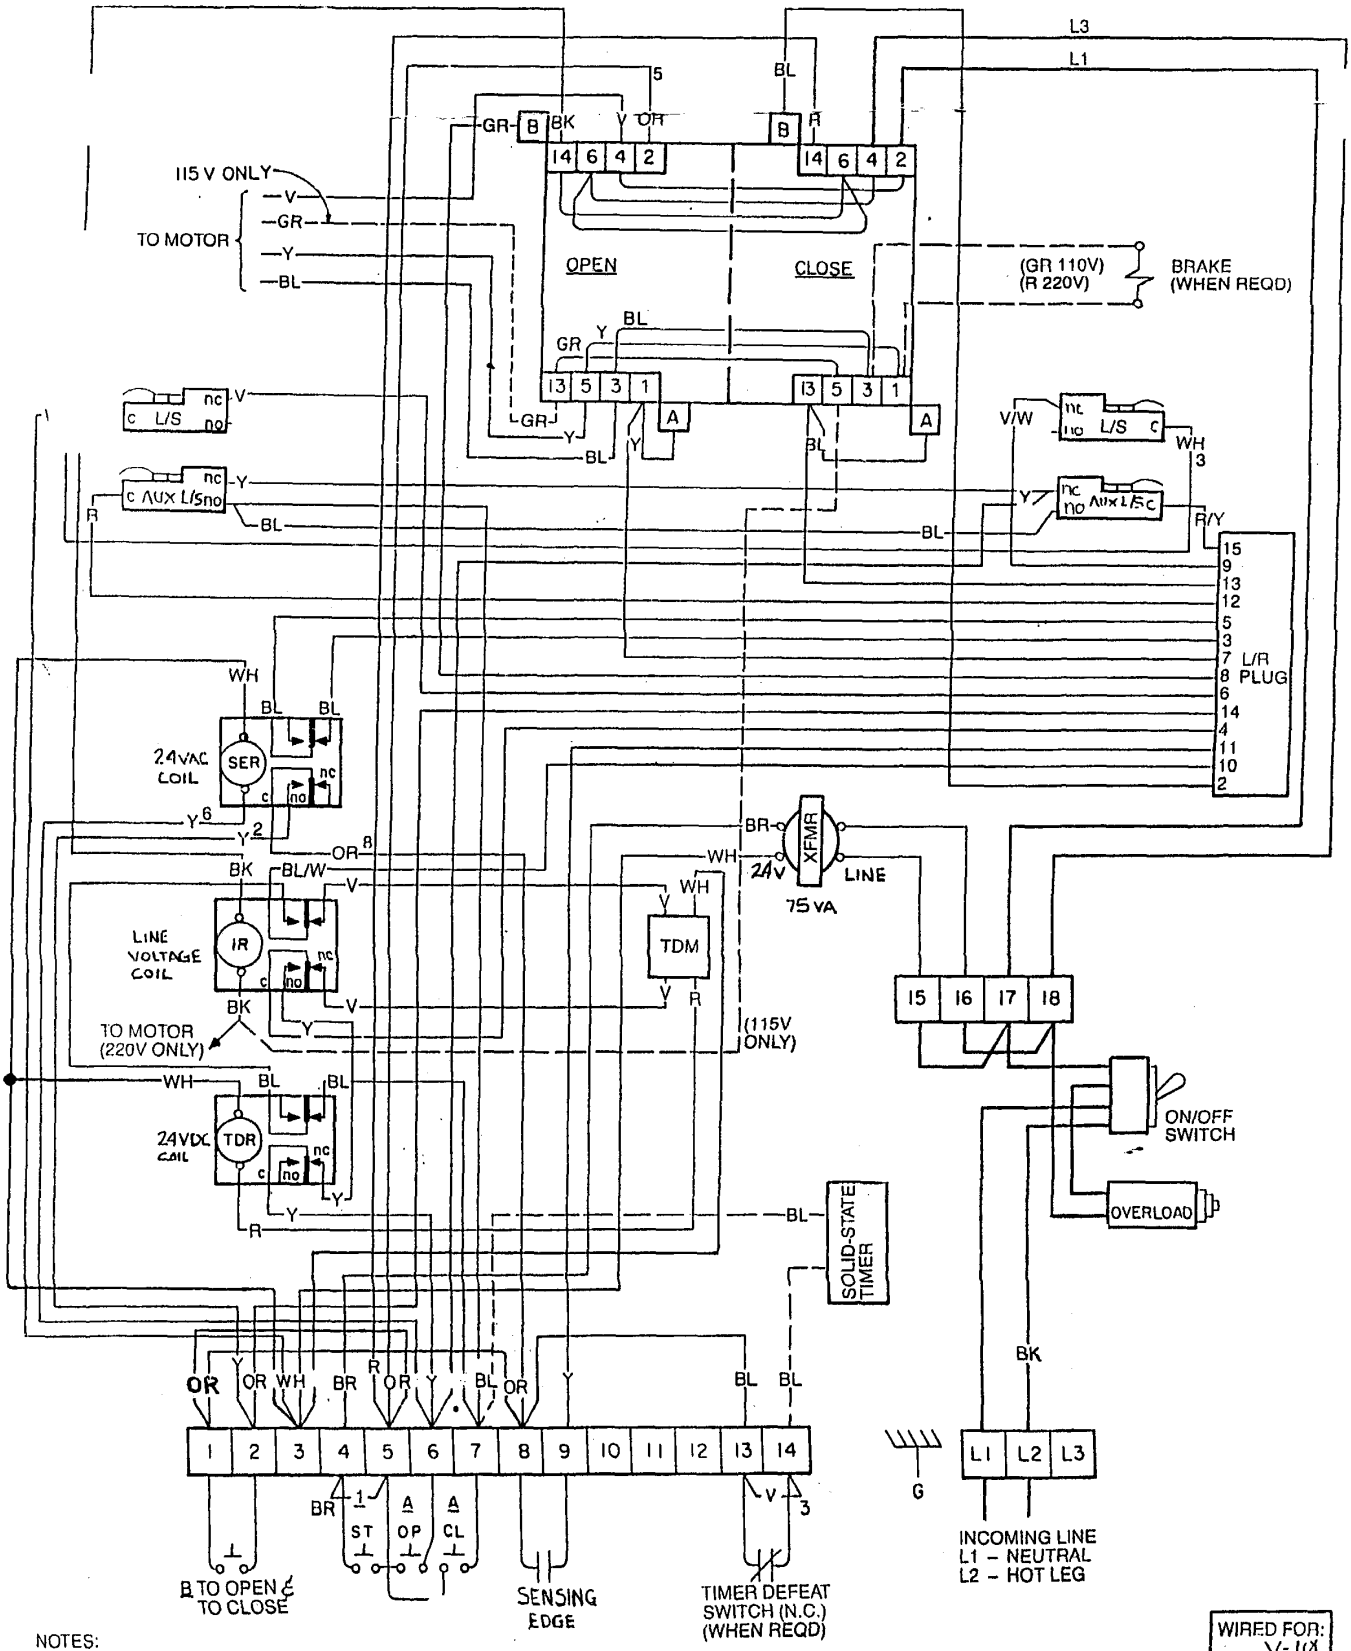

NOTES:

1-WIRE – NOT FURNISHED WHEN EXTERN/ INTLK SWITCH IS USED.

NOT FURNISHED WHEN STOP BUTTON IS USED.

3-WIRE – NOT FURNISHED WHEN TIMER DEFEAT SWITCH IS USED.

A – TREDLES, PULL SWITCHES, KEY SWITCHES, WANDS, PHOTO-ELECTRIC DEVICES, ETC. MAY BE CONNECTED TO TERMINALS INDICATED.

B – REMOTE CONTROL UNITS (EXCLUDING TREADLES AND PHOTO-ELECTRIC UNITS, PULL SWITCHES AND SINGLE CONTACT CONTROL STATIONS, MAY BE CONNECTED TO TERMINALS INDICATED.

WIRED FOR: V-1Ø

GATE OPERATOR	
MTR/CNTR: 1Ø	
DATE: 4-27-82	REV 7
BY: R.L.	5-10-88
WIRING DIAGRAM NO. 331-L/R	
FOR MODEL SG & BSG SINGLE, MASTER-SLAVE	